



UPTIME

MAKING IT IN A HIGH FREQUENCY WORD

Written By
Meredith Christman

uptime®

for reliability leaders and asset managers

feb/mar 18



*It is our great honor to
present this distinction for*



2017

*Best Reliability
Award*



2017

UPTIME AWARDS

RECOGNIZING THE
BEST OF THE BEST!



MAKING IT IN A HIGH FREQUENCY WORLD

Meredith Christman

STRIVING FOR
HIGH FREQUENCY
INDUSTRIAL
ACCELEROMETERS

As predictive maintenance teams in industrial facilities strive for a more complete picture of their equipment's health, high frequency vibration measurements have become a crucial addition for identifying faults, such as motor and pump bearing defects and gear tooth inconsistencies in high-speed gearboxes. As a result, there is an upsurge in demand for vibration sensors with a high frequency response.

HOOKE'S LAW AND THE SPRING-MASS HARMONIC ISOLATOR

What determines the resonant frequency (and therefore high frequency response) of an accelerometer? For that answer, a look into the field of physics and the spring-mass harmonic isolator is required.

A spring-mass harmonic isolator consists of a spring hung vertically from a support structure. A weight is attached to the end of the spring. By pulling the weight down and then releasing it, the

weight/spring assembly will oscillate evenly, both in speed and distance, back and forth across an equilibrium position, recreating the oscillation of a sinusoidal wave.

While the amplitude of the resulting oscillations can be theorized using Newton's second law of motion ($F=ma$), the primary interest of this article is the speed of the resulting oscillations. This speed can be theorized using Hooke's law. In the late 1670s, Robert Hooke proclaimed that natural/resonant frequency is a function of stiffness and mass, as seen in the following formula. In the spring-mass harmonic isolator example, the mass of the weight and the stiffness of the spring are predetermined, so the assembly's oscillation speed cannot be altered unless either the spring or the weight is switched out for an alternative.

$$\text{Natural/Resonant Frequency} = \sqrt{\frac{\text{Stiffness}}{\text{Mass}}}$$

As the formula shows, resonant frequency and mass have an inverse relationship, while resonant frequency and stiffness have a direct rela-

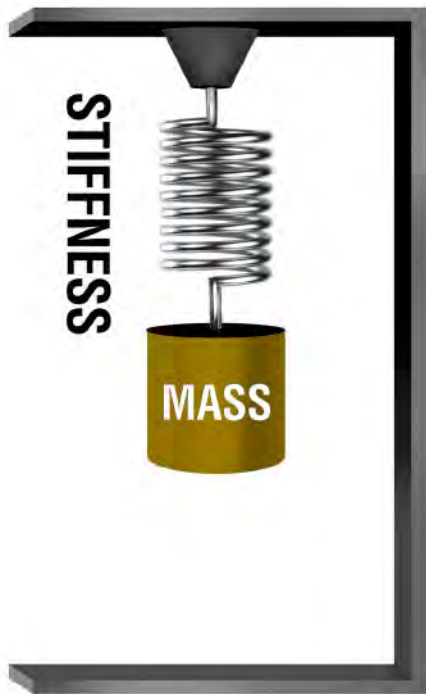


Figure 1: A spring-mass harmonic isolator best describes Hooke's law

relationship. In the world of accelerometers, the mass of the weight correlates to the mass of the accelerometer, while the stiffness of the spring correlates to the stiffness of the accelerometer's mounting. To achieve high frequency measurements, an accelerometer must be as small as possible and have as stiff of a mounting methodology as possible. Each of these two factors is explored in detail in the following sections.

FACTOR #1: STIFFNESS OF SENSOR MOUNTING METHODOLOGY

There are several common methodologies used for vibration sensor mounting. These include stud mounting, adhesive mounting, use of a mounting pad and use of a magnet. Here are the characteristics for each mounting methodology:

Stud Mounting

- **Maximum Frequency Response:** Stud mounting an accelerometer directly to a piece of equipment provides the stiffest possible mounting and, therefore, the highest possible frequency response from the sensor.
- **Equipment Modifications/Permanency of Installation:** To stud mount a sensor to equipment, it is necessary to spot-face a smooth surface and then tap a pilot hole to fit the sensor's mounting thread. Once removed, there is still lingering evidence of past sensor mounting.



Figure 2: Four common mounting methodologies for accelerometers

- **Can Install on Curved Surfaces:** Stud mounting a sensor on a curved surface is not possible.

Adhesive Mounting

- **Maximum Frequency Response:** Mounting an accelerometer with adhesive directly to the equipment provides the second stiffest mounting methodology. Frequency response is reduced only slightly, about 10 to 15 percent, compared to a stud mounted accelerometer.
- **Equipment Modifications/Permanency of Installation:** An adhesive mounted accelerometer can be easily removed with the appropriate dissolving agent for the adhesive. Once removed, there is no evidence of past sensor mounting.
- **Can Install on Curved Surfaces:** Adhesive mounting a sensor on a curved surface is not possible.

Mounting With a Mounting Pad

- **Maximum Frequency Response:** Mounting pads can be adhesively bonded or welded to the equipment's surface. Then, the sensor can be stud mounted to the mounting pad via the tapped hole in the pad. This type of sensor mounting is considered a midway point between the stiff methodology of stud mounting and the flexible methodology of magnet mounting. Frequency response will be reduced by approximately 35 percent compared to stud mounting.
- **Equipment Modifications/Permanency of Installation:** While a weld mounted pad is a relatively permanent installation, an adhesive mounted mounting pad can be easily removed with the use of an appropriate dissolving agent for the adhesive.

- **Can Install on Curved Surfaces:** Mounting a sensor on a curved surface with a mounting pad is not possible.

Mounting With a Magnet

- **Maximum Frequency Response:** Mounting an accelerometer with a magnet is a very flexible mounting methodology that will significantly degrade the sensor's high frequency response by as much as 80 to 85 percent.
- **Equipment Modifications/Permanency of Installation:** The lack of required equipment modifications and the temporary nature of the installation are the reasons why magnet mounting is used in many applications. Magnet mounting offers the most convenient method of temporary sensor installation for route-based measurements and data collection.
- **Can Install on Curved Surfaces:** Magnet mounting a sensor on a curved surface is possible when a dual rail magnet is used.

FACTOR #2: SENSOR MASS

Sensor manufacturers continue to make smaller and smaller accelerometers in order to satisfy customers' requests for sensors capable of high frequency measurements. This effort is challenging because manufacturers must balance the small size with the need for a rugged sensor that can withstand harsh environments.

MOST INDUSTRIAL CUSTOMERS REQUIRE:

- **Robust Housing:** In the world of industrial accelerometers, the robustness of the sensor's housing is not determined by one single fac-



Figure 3: A triaxial accelerometer with a footprint less than one inch square and a 13kHz frequency response on all three axes

tor. Rather, it is determined by the housing material, the level of seal the housing provides and the electrical isolation of the housing. Most industrial accelerometer housings are 304 or 316 stainless steel and hermetically sealed in order to withstand chemical exposure and wide operating temperature ranges. An isolated case housing allows an accelerometer to be mounted on equipment with poor electrical grounding without running the risk of signal contamination. This isolation is typically achieved with the use of a Faraday cage, a continuous enclosure around the sensor's electronics to repel noise.

- **Rugged Connectors:** Connectors must be able to withstand repeated use in harsh conditions. Military-style connectors are preferred, as they, along with their mating cables, can withstand extreme conditions.

Despite the challenges, sensor manufacturers have been able to successfully shrink the size of industrial accelerometers to about the size of a quarter. For example, some high frequency triaxial accelerometers measure just 0.95 inch by 0.95 inch and have a 13kHz frequency response on all three axes, isolated stainless steel case housing and rugged connectors.

CONCLUSION

High frequency measurements are gaining prominence as industrial predictive maintenance teams seek ways to get the most comprehensive look at the health of assets. The size of the sensor and the stiffness of sensor mounting methodology are the two most important factors contributing to a sensor's ability to successfully provide high frequency measurements.



2017 Solution Award Winner
Asset Condition Management
High Frequency Triaxial ICP® Accelerometer




Meredith Christman is the Product Marketing Manager for IMI Sensors, a Division of PCB Piezotronics, Inc. Meredith is responsible for product development and management of the company's industrial and energy product lines. Prior to her current role, she worked for 10 years as Product Manager of Air Management Products with Roberts-Gordon LLC. www.PCB.com

Connecting Machinery to the Industrial Internet of Things



Condition Monitoring for Remote and In-plant Installations

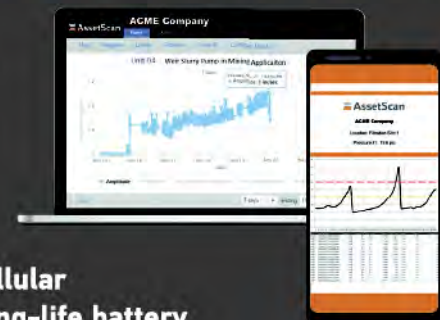

- ✓ Cellular
- ✓ Long-life battery
- ✓ New or existing sensors
- ✓ Predictive analytics for bearing faults
- ✓ Start small and scale

800-523-6996

www.assetscan.com



3425 Walden Avenue, Depew, NY 14043-2495 USA

Toll-Free in the USA: 800 959 4464

Phone: 1 716 684 0001 | Email: info@pcb.com

IMI Sensors, a division of PCB Piezotronics, Inc. manufactures industrial vibration monitoring instrumentation, such as accelerometers, vibration transmitters and switches that feature rugged stainless steel housings and survive in harsh environments like paper and steel mills, mines, gas turbines, water treatment facilities and power plants. Integrating with portable analyzers and PLC's, IMI instrumentation helps maintenance departments reduce downtime and protect critical machinery. Visit IMI Sensors at www.pcb.com. PCB Piezotronics, Inc. is a wholly owned subsidiary of MTS Systems Corporation. Additional information on MTS can be found at www.mts.com.

© 2019 PCB Piezotronics, Inc. In the interest of constant product improvement, specifications are subject to change without notice. PCB®, ICP®, Swiveler®, Modally Tuned®, and IMI® with associated logo are registered trademarks of PCB Piezotronics, Inc. in the United States. ICP® is a registered trademark of PCB Piezotronics Europe GmbH in Germany and other countries. UHT-12™ is a trademark of PCB Piezotronics, Inc. SensorLine™ is a service mark of PCB Piezotronics, Inc. SWIFT® is a registered trademark of MTS Systems Corporation in the United States.

AR-Uptime-0719



MTS Sensors, a division of MTS Systems Corporation (NASDAQ: MTSC), vastly expanded its range of products and solutions after MTS acquired PCB Piezotronics, Inc. in July, 2016. PCB Piezotronics, Inc. is a wholly owned subsidiary of MTS Systems Corp.; IMI Sensors and Larson Davis are divisions of PCB Piezotronics, Inc.; Accumetrics, Inc. and The Modal Shop, Inc. are subsidiaries of PCB Piezotronics, Inc.